


Terminals in Hydro-Temp System

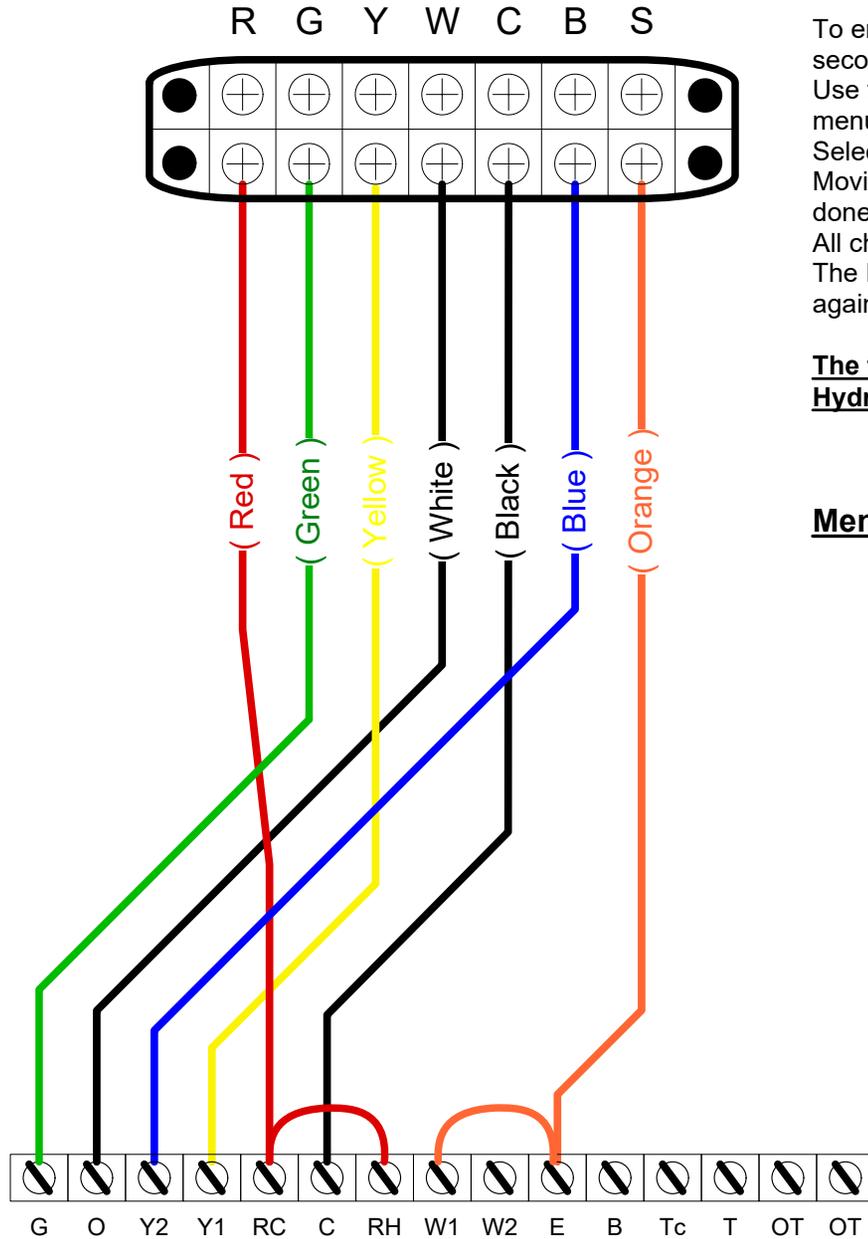

Terminals on Thermostat

To enter the Installer Setup Menu press and hold the Setup button for 10 seconds. Use the NEXT button to scroll through its options. As you proceed, the menu item number will be displayed in the left portion of the screen. Selections can be changed by pressing the UP/DOWN button. Moving from one menu item to the next and acceptance of changes is done by pressing the NEXT button. All changes become effective when the unit exits the Installer Setup mode. The Installer Setup mode will be exited when the Setup button is pressed again, or if no other keys are pressed for 20 seconds.

The following installer setup settings must be changed to operate the Hydro-Temp system.

Menu Item	Display	Change to
01	System Type	Heat Pump
03	Compressor Stages	2

					
Title					
PSP722E Wiring Diagram					
Project					Units
					Inches
THIS DRAWING, THE DESIGN AND DEVELOPMENTS ARE THE PROPERTY OF AND ARE NOT TO BE USED OR REPRODUCED IN ANY WAY WITHOUT WRITTEN CONSENT OF HYDRO-TEMP LTD.					
DR. BY	JR	DATE	04/18/16	SCALE	DWG. NO.
REV		DATE		1:1	H004252A
					1